


**Core FB MC Operational KPI report** 

May 2023



# **Overview of Operational KPIs**

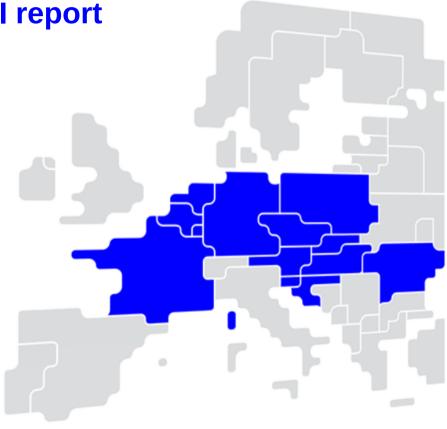

#### **Adjustment for minimum RAM Inclusion**

- KPI 1: Average maximum AMR per CNE
- KPI 2: Average maximum AMR per TSO

#### TSOs' adjustment after validation

- KPI 3: Share of MTUs with intervention per TSO
- KPI 4: Average IVA applied for each CNE affected by TSO intervention

#### **Power System Impact Analysis**

- KPI 5: Min & max net positions per BZ hub
- KPI 6: Virtual margins at market balance for CORE TSOs
- KPI 7: Non-Core exchanges delta flow

#### **Non-costly Remedial Action Optimization Analysis**

- KPI 8: Relative Time Share of Applied RAs, by TSO, Type and Mode
- KPI 9: Most limiting CNEC per TSO (NRAO)
- KPI 10: Average variation of relative RAM before and after NRAO

#### **Market Impact Assessment**

- KPI 11: Most often presolved CNEs (top 20)
- KPI 12: Most limiting CNEs (top 20)
- KPI 13: Allocation Constraints

# **KPI 1: Average maximum AMR per CNE (Top 10)**


# **KPI 2: Average maximum AMR per TSO**




CNE	Average Maximum AMR (MW)	AMR as % of Fmax
[BE-BE] Y-Gramme (-Courcelles - Tergnee) 380.31 [OPP]	514.58	33.47%
[BE-BE] Champion - Gramme 380.32 [OPP]	423.97	25.15%
[BE-BE] Champion - Courcelles 380.56 [DIR]	405.25	25.23%
[BE-BE] Y-Courcelles (-Gramme - Tergnee) 380.31 [DIR]	382.67	24.83%
[CZ-CZ] Slavetice - Sokolnice - V436 [DIR]	324.65	23.42%
[CZ-D8] Hradec - Rohrsdorf - V446 [OPP] [CZ]	311.22	11.67%
[CZ-D8] Hradec - Rohrsdorf - V445 [OPP] [CZ]	309.08	11.59%
[FR-FR] Faux Fresnay - Mery sur Seine 1 [DIR]	269.24	15.44%
[D7-D2] Hanekenfaehr - Doerpen West [OPP] [D2]	252.20	13.11%
[FR-FR] Avelin - Mastaing 1 [OPP]	243.41	13.08%

Average maximum AMR per TSO
22.69
472.07
335.37
353.66
135.98
315.83
368.87
327.64
27.77
204.07

TSO	Average maximum AMR per TSO
NL	359.60
PL	62.66
RO	59.76
SI	37.96
SK	251.24

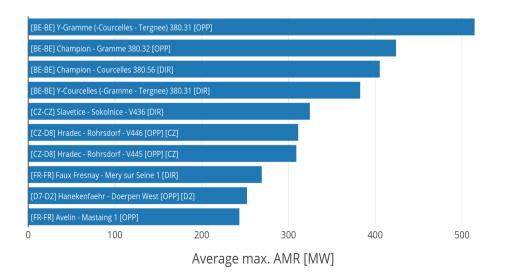

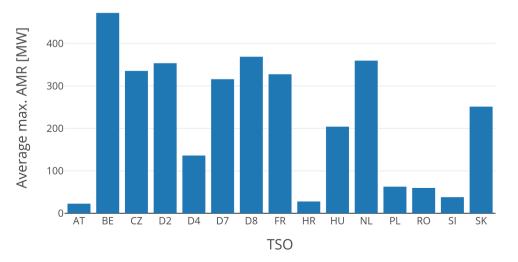

#### **KPI 3: Share of MTUs with intervention per TSO**



Total BDs

31

Total MTUs

744

MTUs without IVA

173

Share of distinct MTUs without IVA

23.25%

MTUs with IVA


571

Share of distinct MTUs with IVA

76.8%


Share of distinct MTUs with IVA	Distinct MTUs with IVA
0.00%	0
0.54%	4
1.48%	11
0.67%	5
0.54%	4
0.00%	0
4.03%	30
0.00%	0
19.22%	143
1.08%	8
	with IVA  0.00%  0.54%  1.48%  0.67%  0.54%  0.00%  4.03%  0.00%  19.22%

TSO	Share of distinct MTUs with IVA	Distinct MTUs with IVA
BE	13.31%	99
NL	0.67%	5
FR	25.00%	186
RO	47.72%	355
HR	1.34%	10

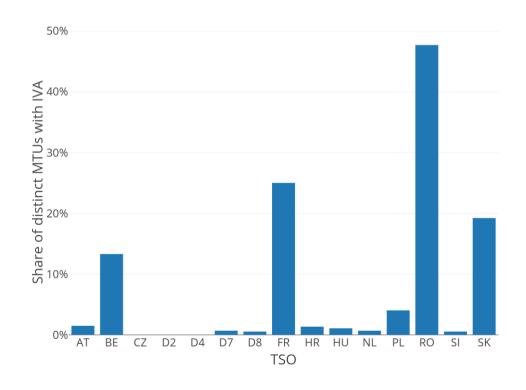


#### KPI 4a: Average IVA applied for each CNE affected by TSO intervention



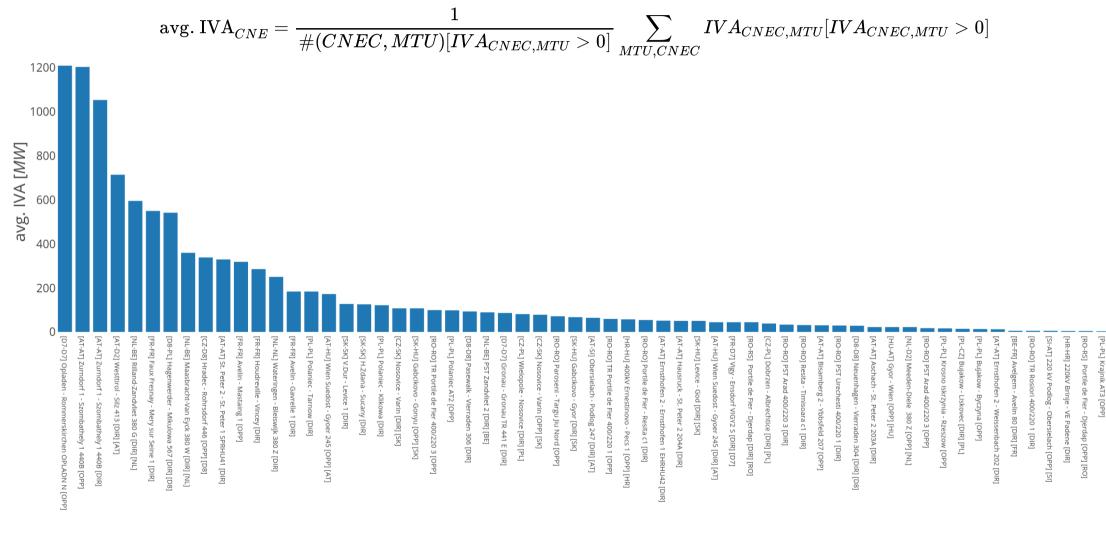


#### KPI 4b: Average relative IVA applied for each CNE affected by TSO intervention




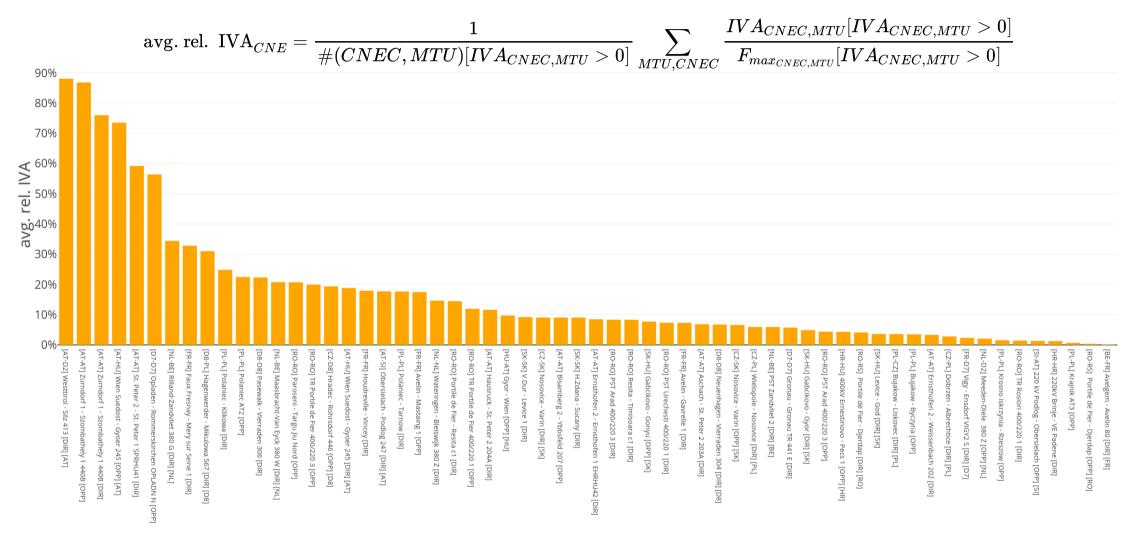




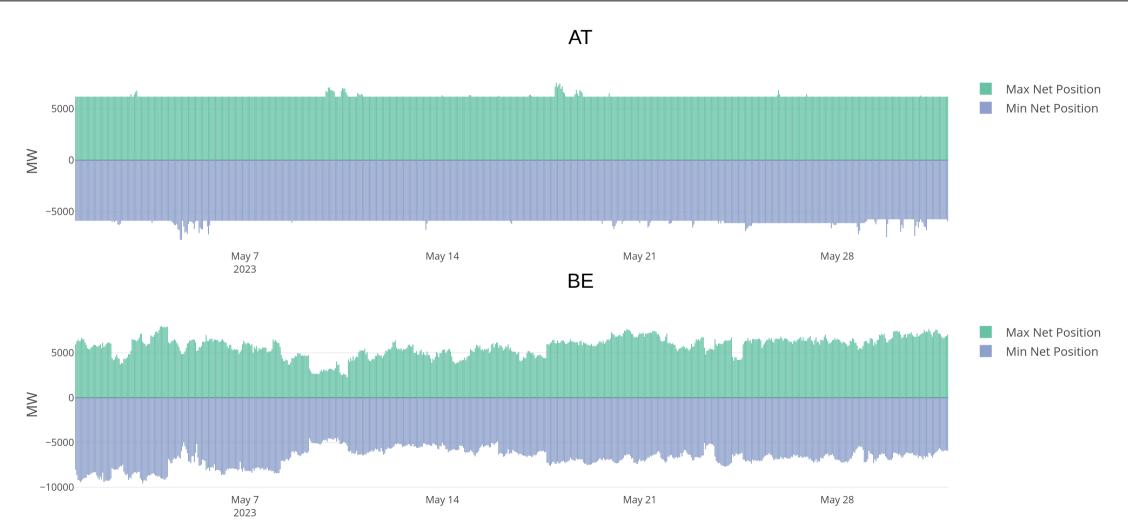




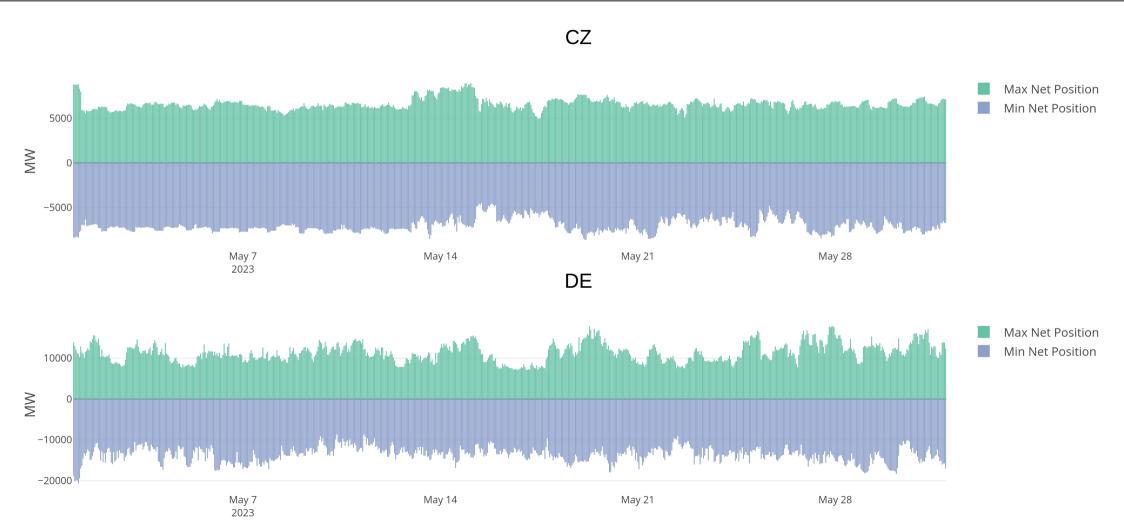




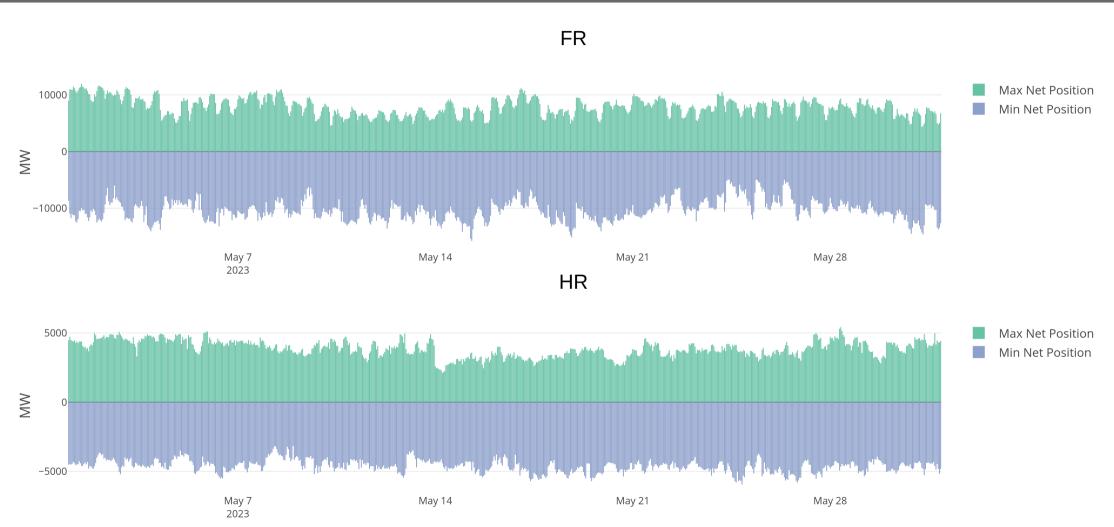




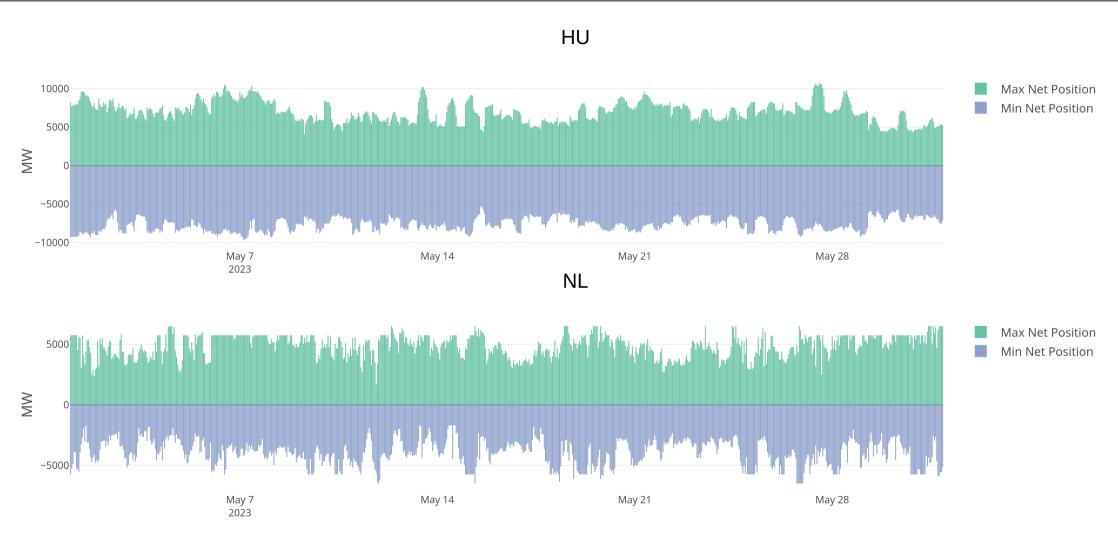



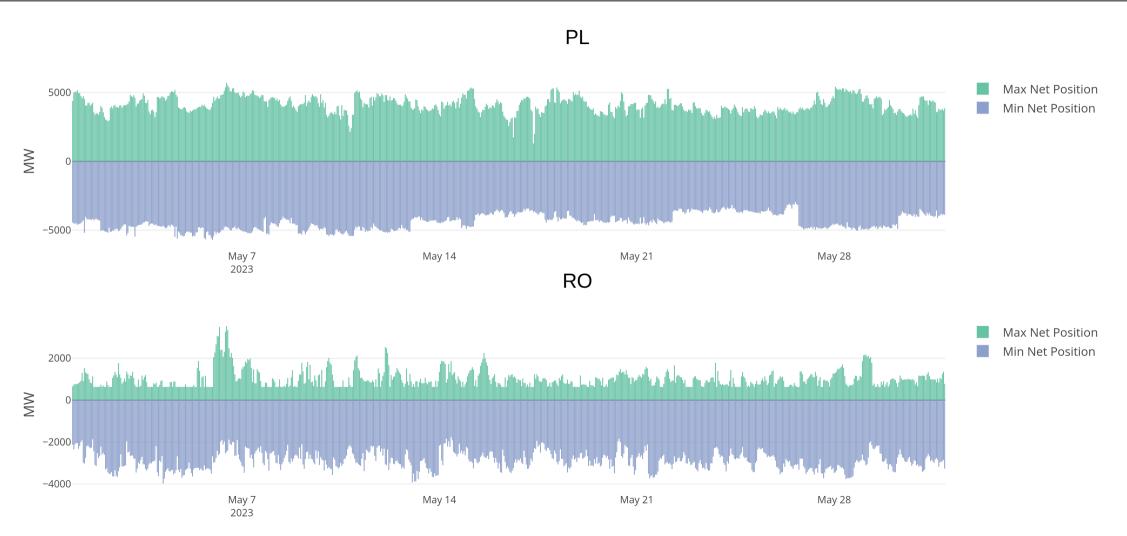




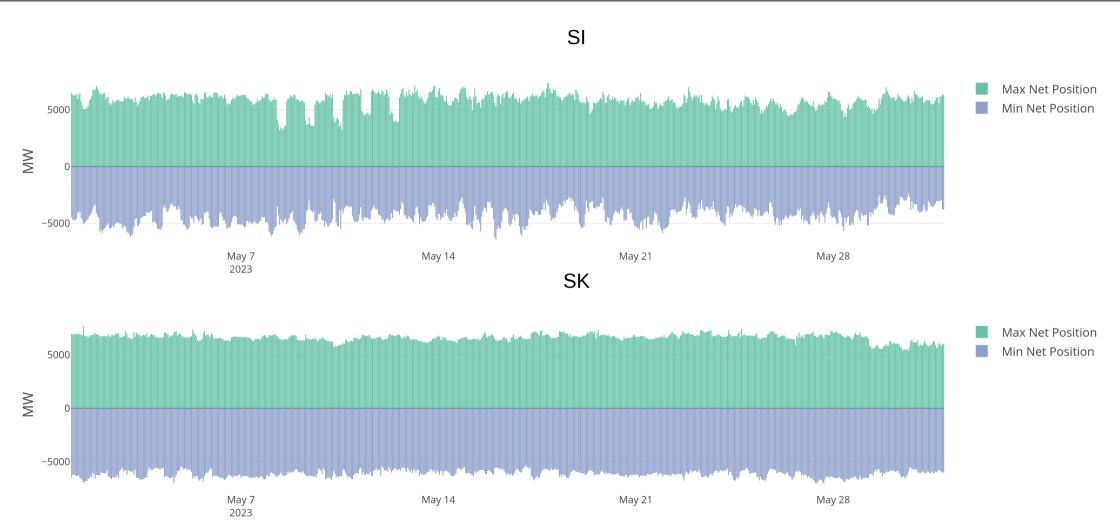

#### **KPI 6a: Highest virtual margins at market balance for CORE TSOs**




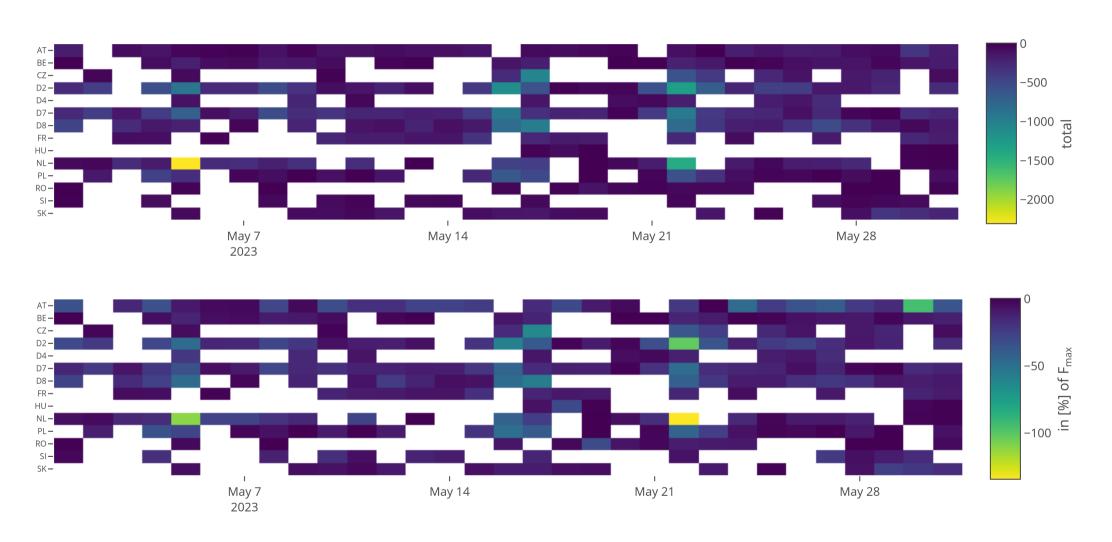









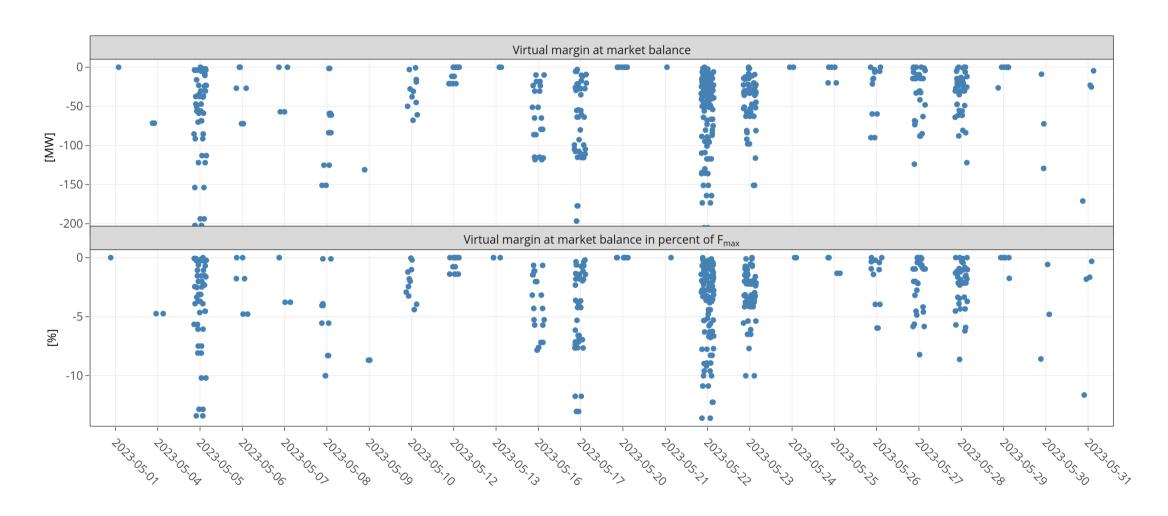




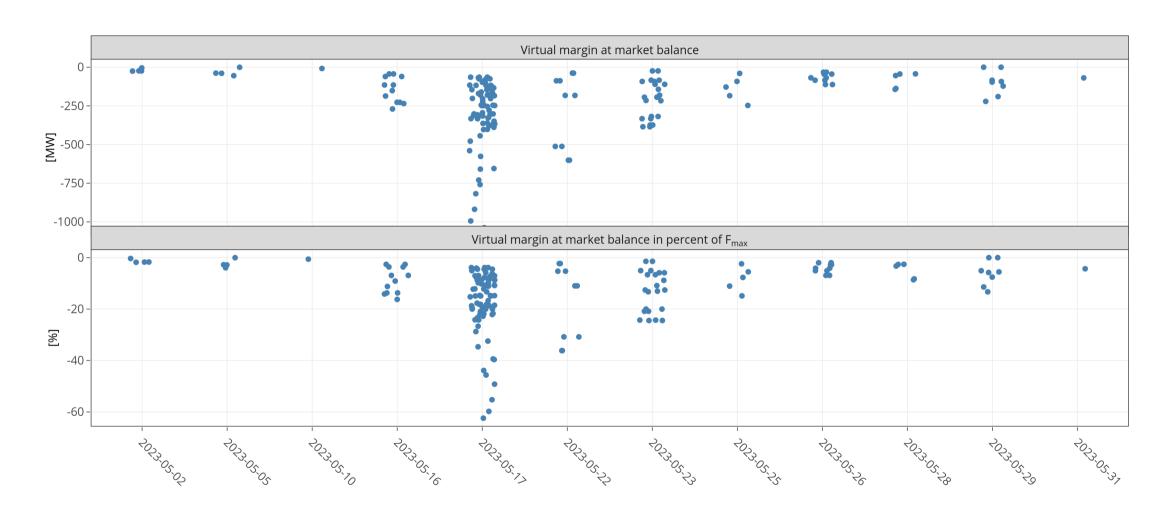




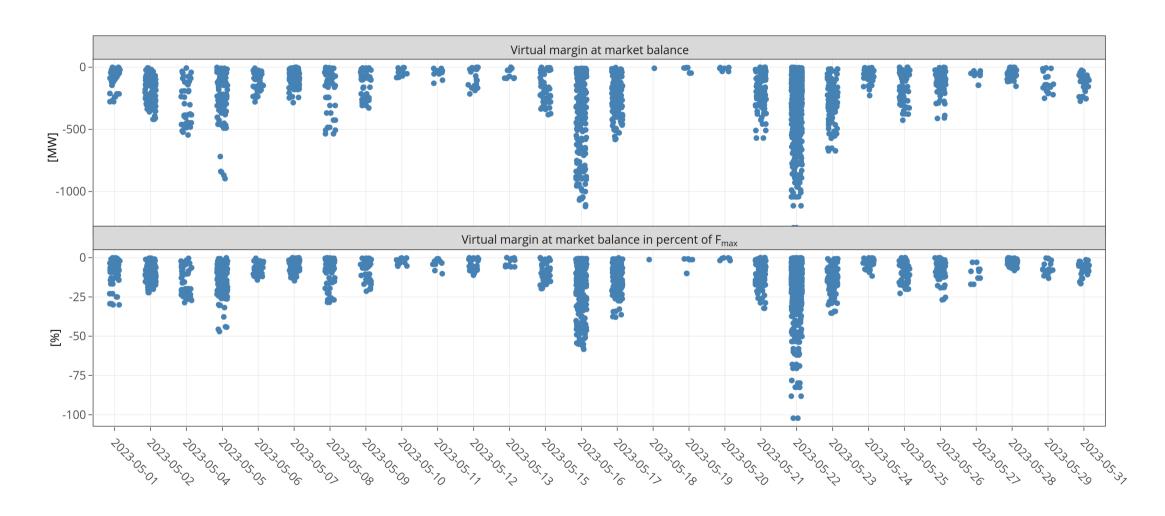




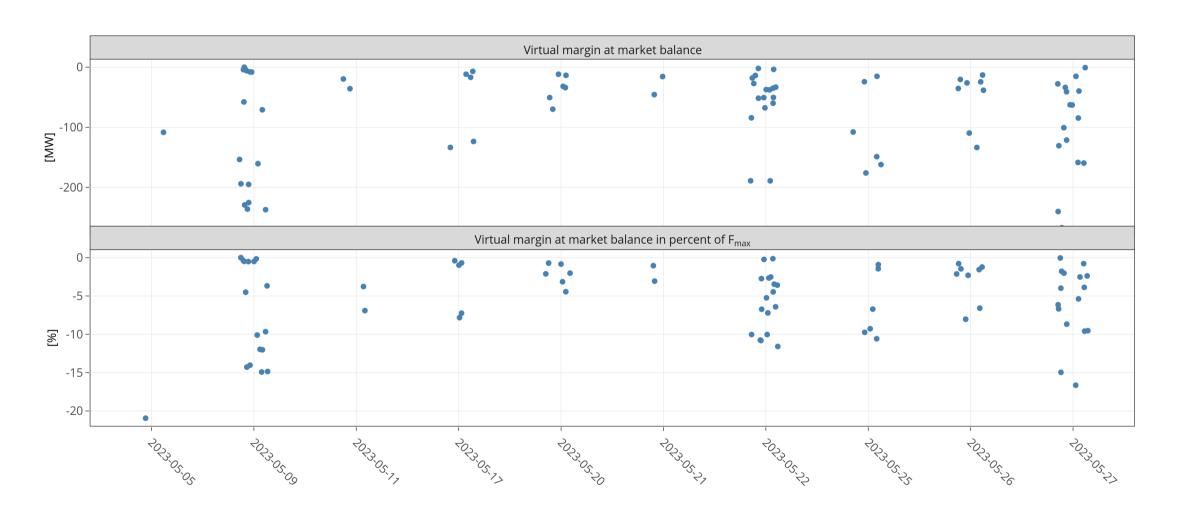




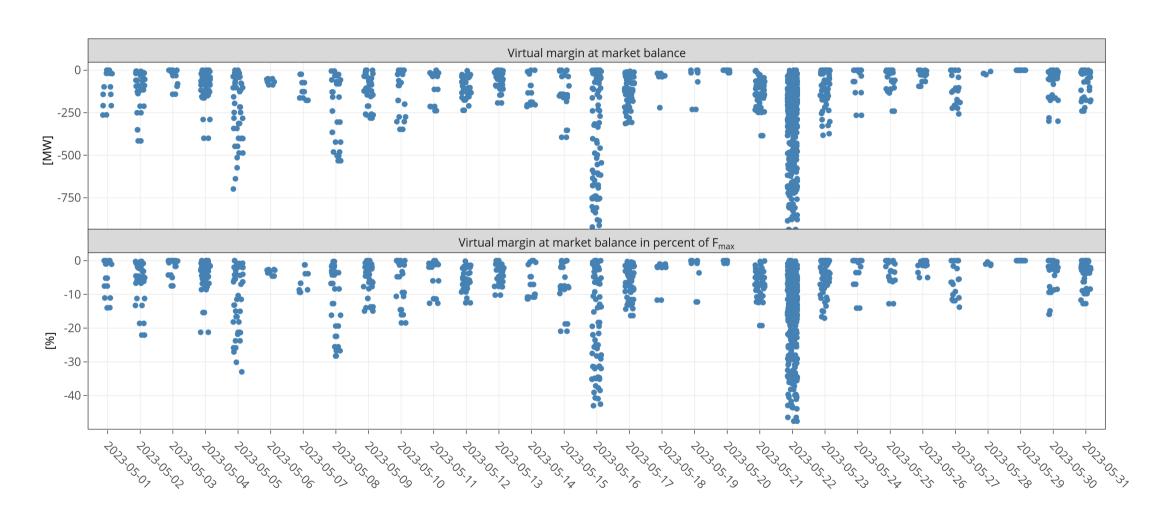




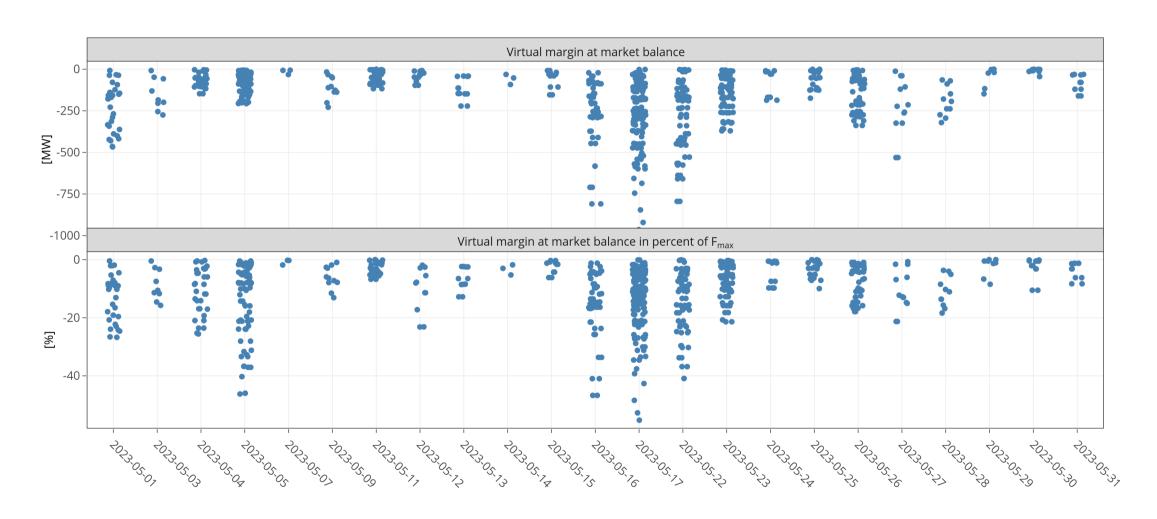




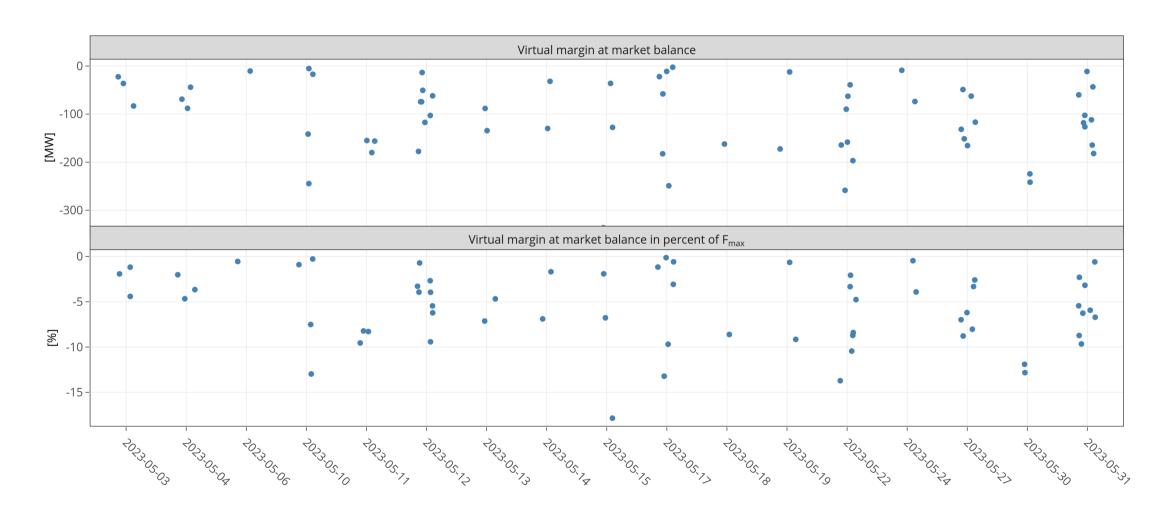




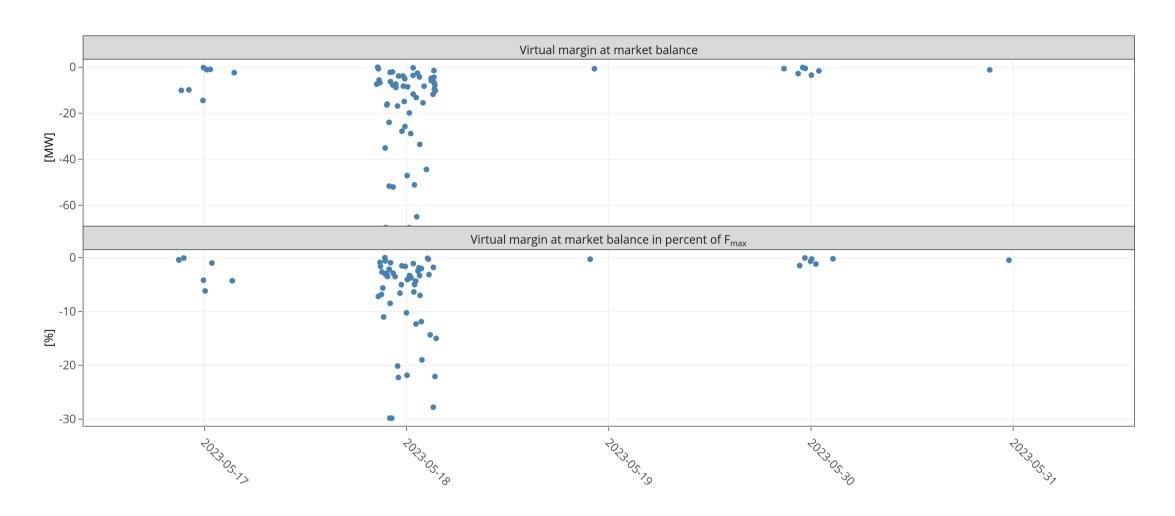




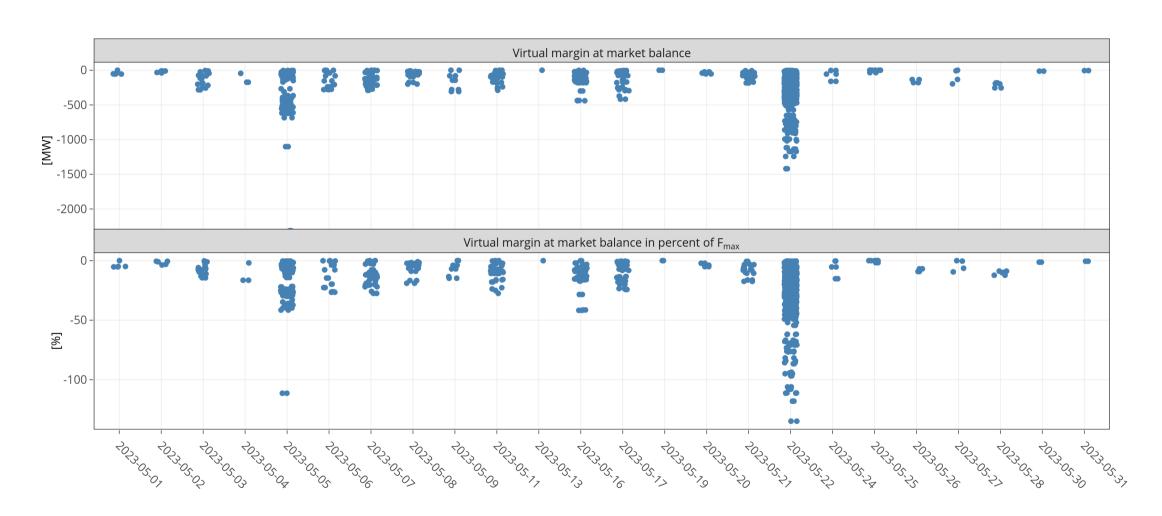




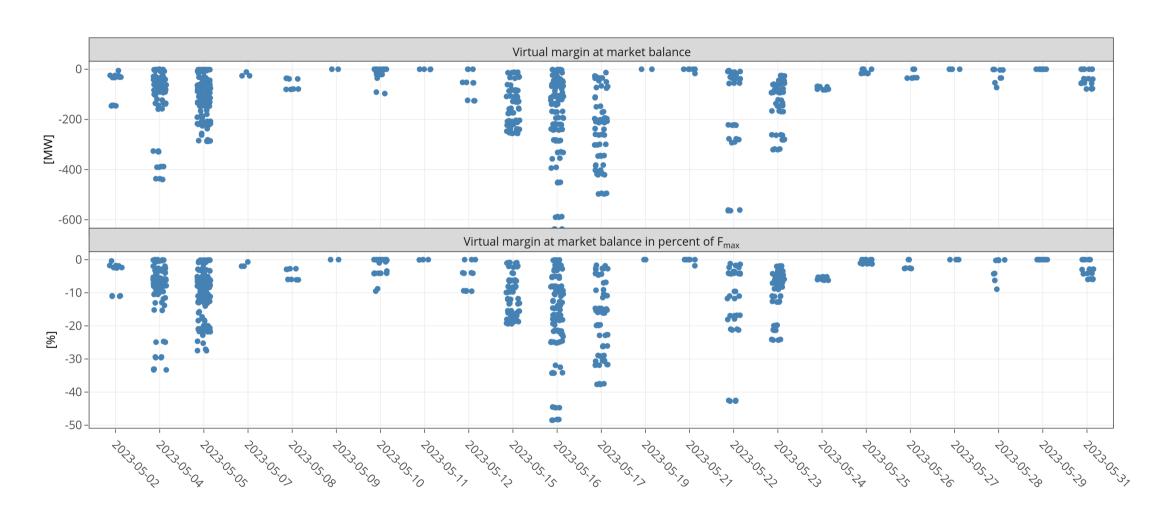




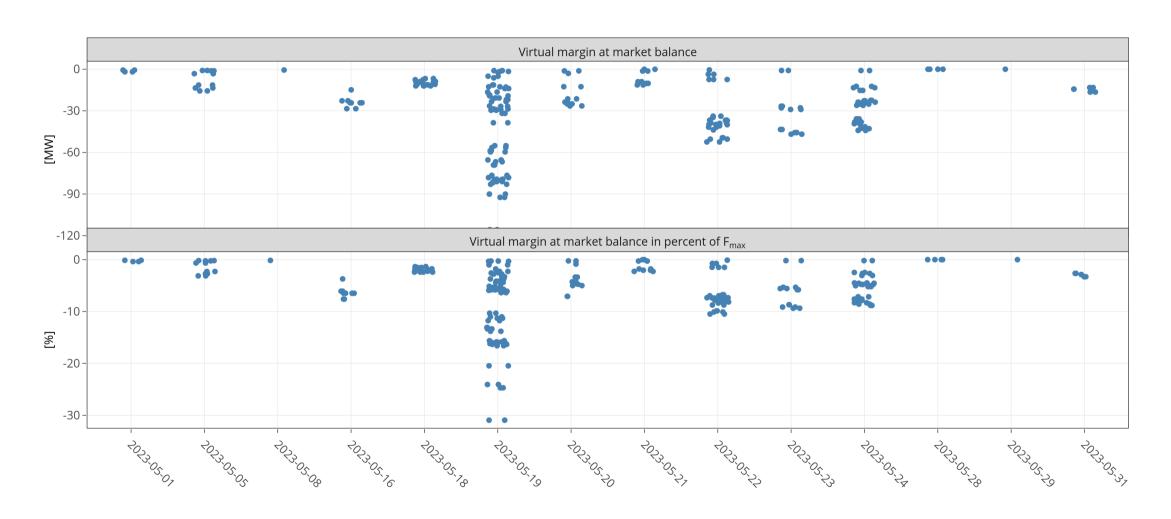



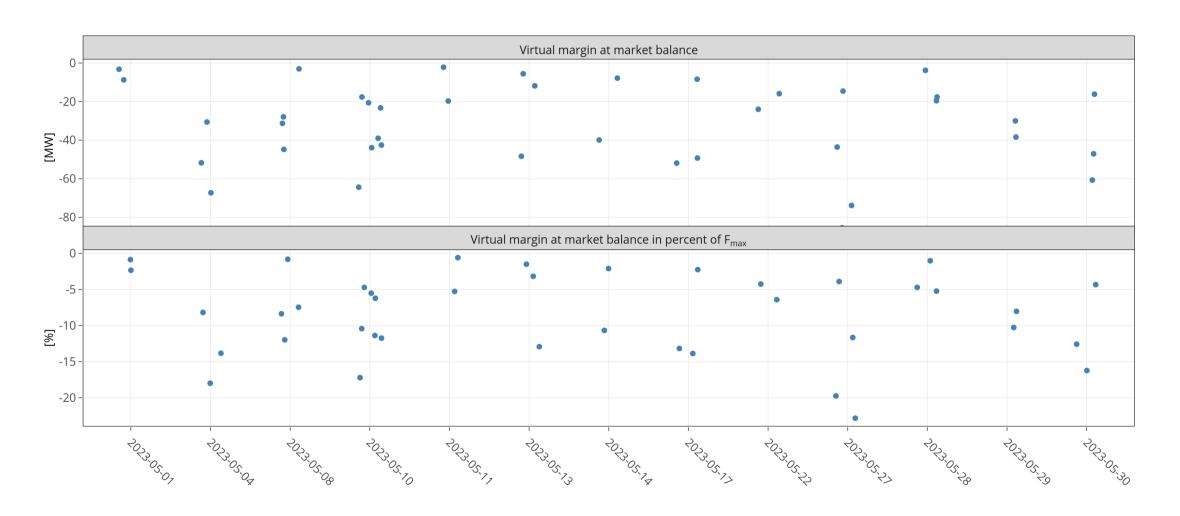




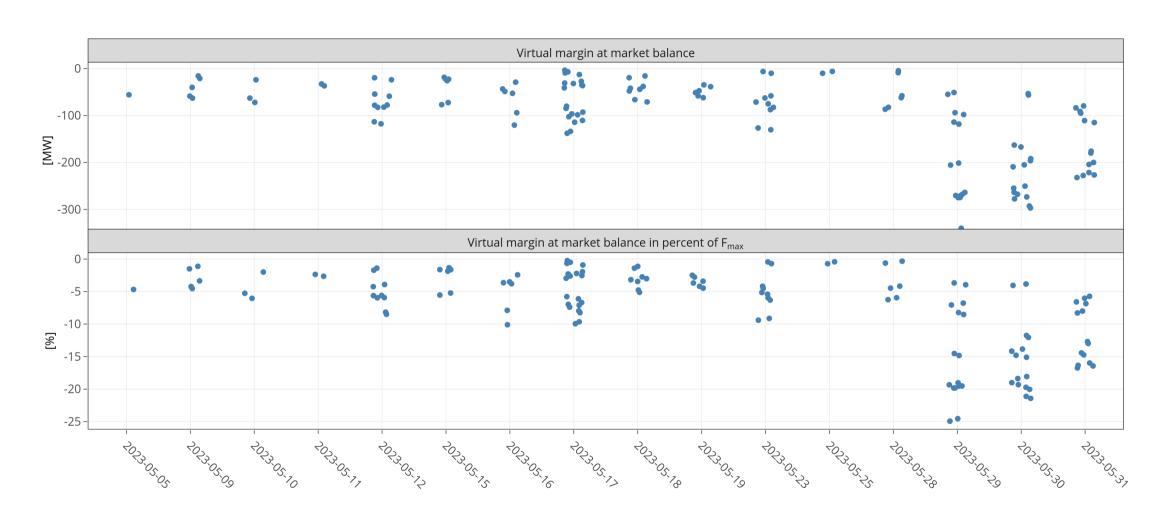


## **KPI 7: Non-Core exchanges AC delta flow**



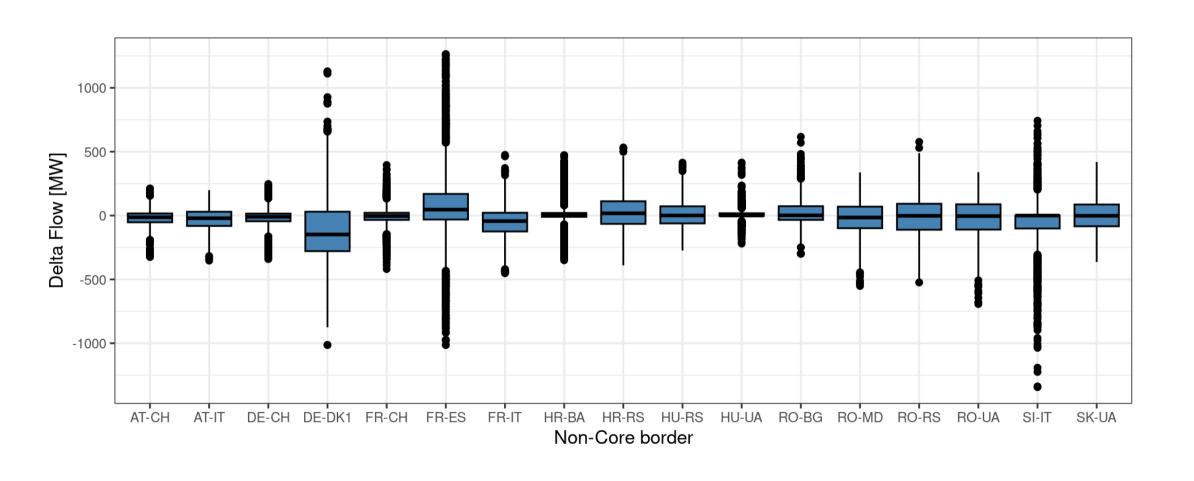

### **KPI 7: Non-Core exchanges DC delta flow**




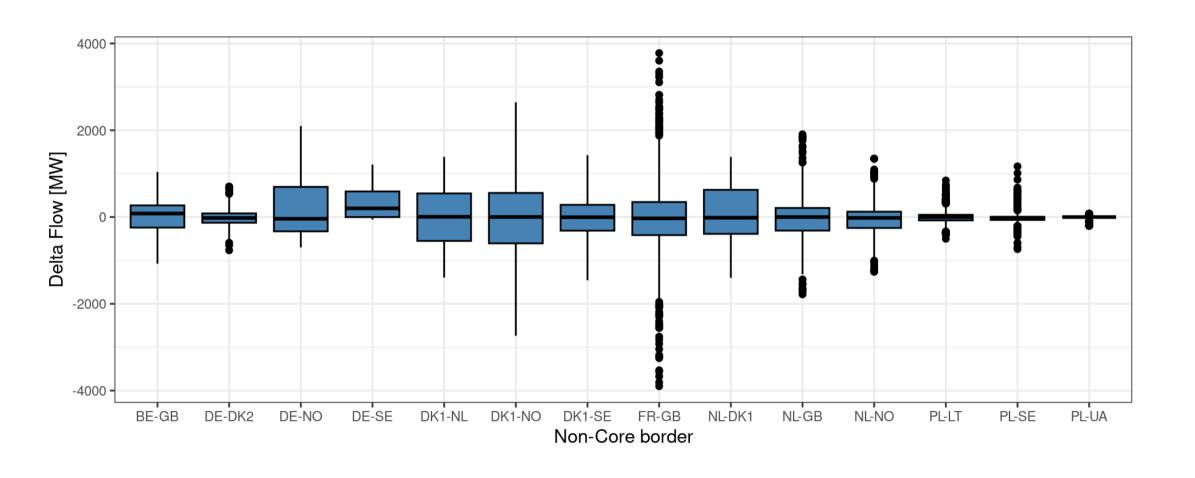

#### **KPI 8: NRAO – Applied Remedial Action**




In the following plots, the relative time share relates to the hours labeled 'NRAO Ran and Applied RAs'.

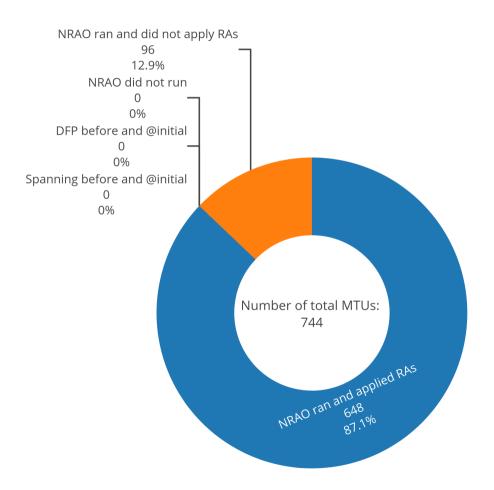


### **KPI 8: Relative Time Share of Applied RAs, by TSO, Type and Mode**



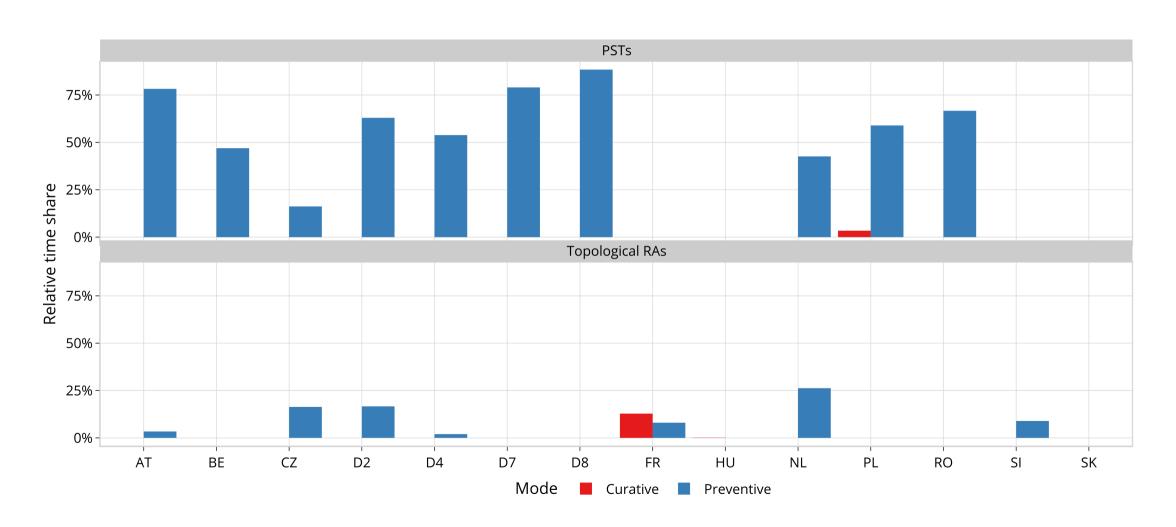


# KPI 8: Relative Time Share of Applied RAs, by TSO, Type and Mode Relative Time Share of Applied PSTs in Preventive Mode



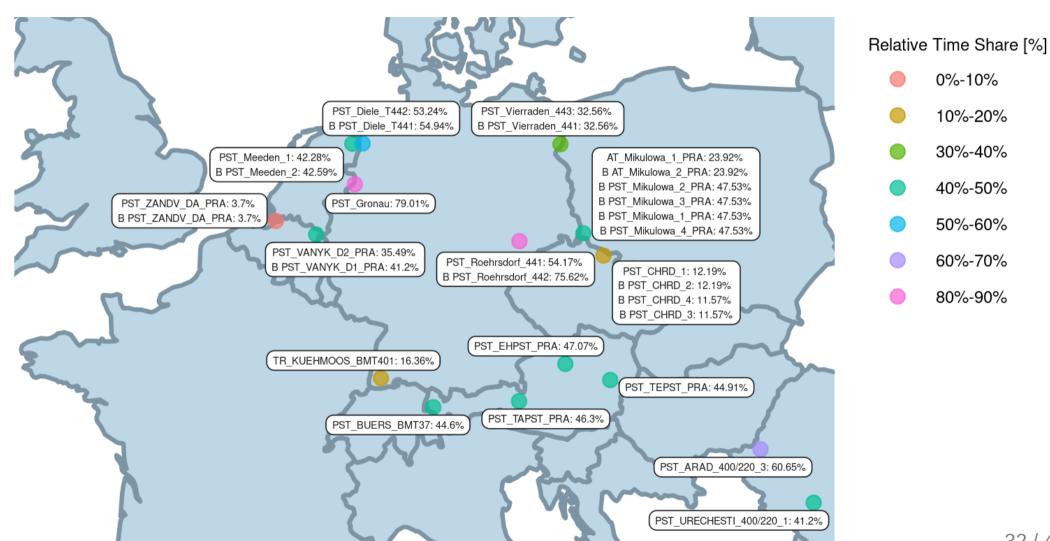

# KPI 8: Relative Time Share of Applied RAs, by TSO, Type and Mode Relative Time Share of Applied PSTs in Curative Mode



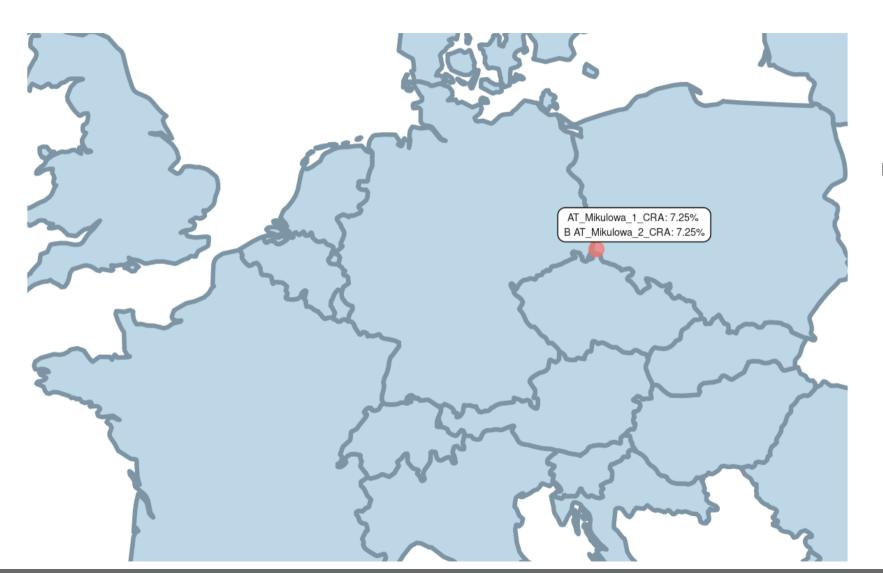


Relative Time Share [%]

0%-10%

## KPI 8: Relative Time Share of Applied RAs, by TSO, Type and Mode **Relative Time Share of Applied Topological RAs in Preventive Mode**



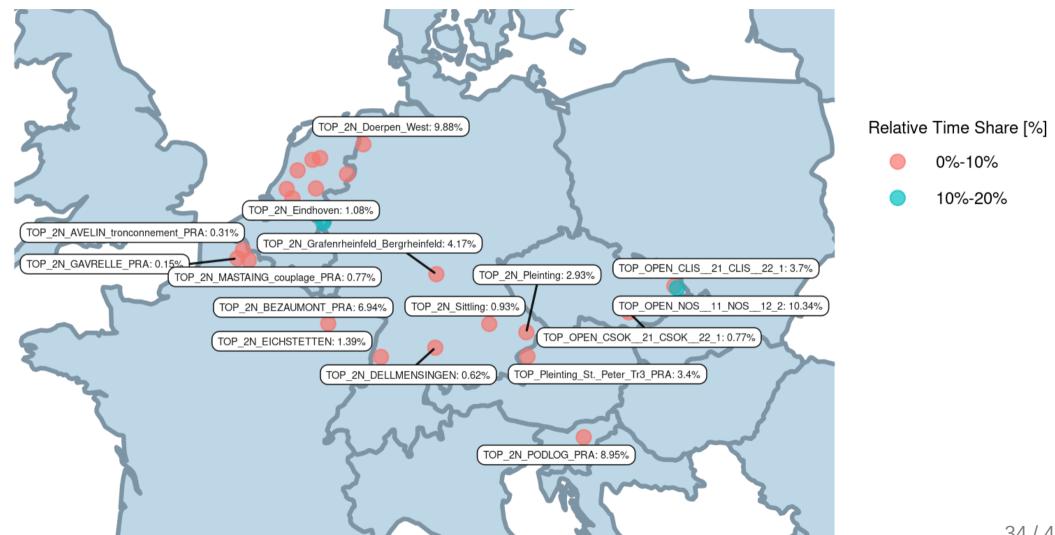

# **KPI 8: Relative Time Share of Applied RAs, by TSO, Type and Mode Relative Time Share of Applied Topological RAs in Curative Mode**






#### **KPI 9: Most limiting CNEC per TSO (NRAO)**



The graph below shows the distribution of CNECs which are the most limiting from NRAO perspective, these are the CNECs with lowest relative RAM per MTU

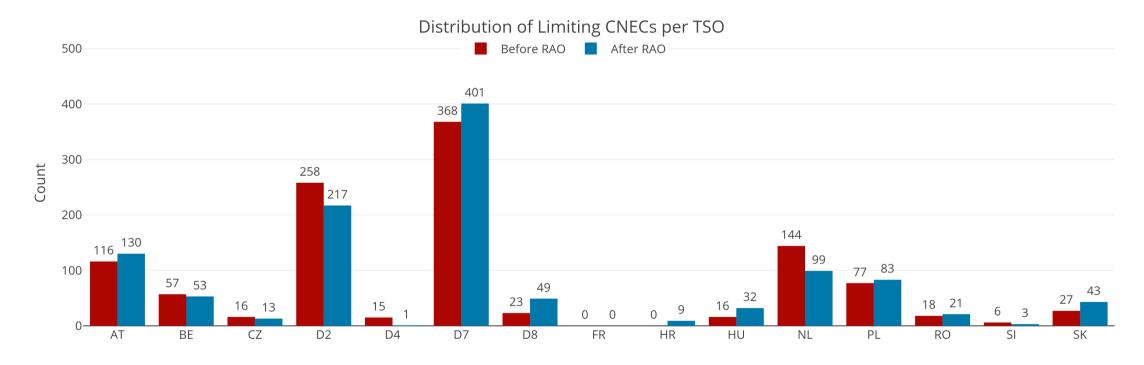

As expected, there is redistributing of the most limiting CNECs. This is because the application of Remedial Actions does not eliminate flows but re-routes, reducing the flows on some limiting CNECs and increasing the load on others, which at the end impacts also the RAM values.


#### KPI 10: Average variation of relative RAM before and after NRAO



The graph shows average values of relative RAM before and after NRAO, per TSO on the most limiting CNECs from NRAO perspective. Selected CNECs before RAO are the same as after RAO, and average computed for MTUs when was used further in the process.

- Most limiting element from NRAO perspective is the one which has the lowest relative RAM per MTU
- To determine value of relative RAM, the following formula was used

$$RAM_{rel} = \left\{ egin{array}{c} rac{RAM_{nrao}}{\sum_{(A,B) \in neighbouring\ Core\ bidding\ zones\ pairs} |PTDF_{A 
ightarrow B,nrao}|},\ if\ RAM_{nrao} \geq 0 \ \ RAM_{nrao},\ if\ RAM_{nrao} < 0 \end{array} 
ight.$$

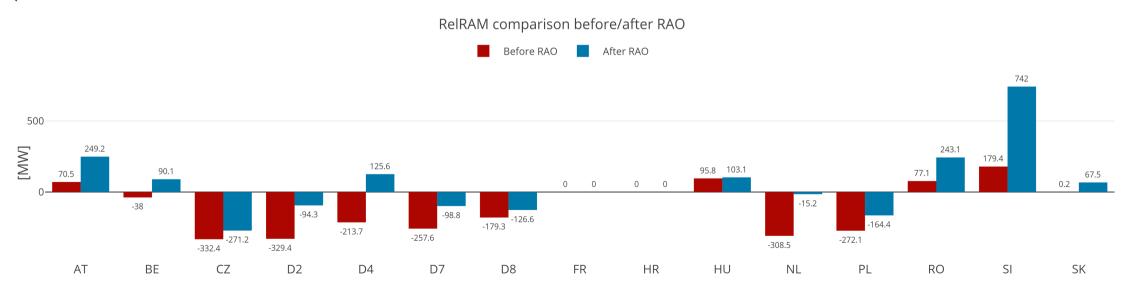

#### **KPI 11: Most often presolved CNEs (top 20)**



CNE &	Distinct hours CNE was presolved	Count of presolved CNECs	Avg RAM/Fmax	Min RAM/Fmax	Max RAM/Fmax	Max z2zPTDF	Max sum z2zPTDF
[SK-UA] V.Kapusany - Mukachevo (WPS) [DIR] [SK]	744	744	85.26%	63.05%	115.63%	0.2287	0.8176
[CZ-SK] Nosovice - Varin [OPP] [SK]	744	1884	105.68%	72.73%	148.32%	0.4644	1.6801
[FR-D7] Vigy - Ensdorf VIGY2 S [DIR] [D7]	744	834	42.80%	17.89%	73.20%	0.2336	0.6181
[HR-SI] 220kV Pehlin - Divaca [DIR] [HR]	744	744	67.28%	33.69%	94.65%	0.2271	0.5761
[SK-SK] Gabcikovo - P.Biskupice [DIR]	743	743	83.88%	70.13%	105.57%	0.3365	1.2381
[HR-SI] 220kV Pehlin - Divaca [OPP] [HR]	740	1056	105.68%	71.12%	147.86%	0.2271	0.5761
[AT-CZ] Duernrohr 1 - Slavetice 437 [OPP] [AT]	740	740	66.21%	40.06%	86.71%	0.3937	1.6022
[RO-RO] TR Rosiori 400/220 1 [DIR]	740	740	62.64%	27.50%	102.50%	0.1484	0.3114
[NL-BE] PST Zandvliet 2 [DIR] [BE]	740	1902	69.10%	20.03%	108.98%	0.4818	1.1144
[CZ-SK] Sokolnice - Stupava [OPP] [SK]	738	738	108.79%	86.44%	133.19%	0.3876	1.5905
[SI-HU] Cirkovce - Heviz [DIR] [HU]	736	739	101.54%	79.60%	131.05%	0.2135	1.1519
[SI-HU] Cirkovce - Heviz [OPP] [HU]	736	736	75.07%	56.68%	96.57%	0.2135	1.1519
[CZ-SK] Nosovice - Varin [DIR] [SK]	726	1208	72.26%	38.00%	104.45%	0.4644	1.6801
[BE-FR] Achene - Lonny 380.19 [OPP] [BE]	721	2086	92.73%	50.00%	133.44%	0.362	0.7687
[RO-RO] TR Portile de Fier 400/220 1 [OPP]	715	1109	20.64%	0.00%	87.80%	0.1906	0.2133
[SK-UA] V.Kapusany - Mukachevo (WPS) [OPP] [SK]	708	708	94.47%	72.43%	117.10%	0.2287	0.8176
[NL-BE] PST Van Eyck 2 [OPP] [BE]	704	2523	77.70%	33.49%	119.43%	0.4288	0.9926
[HR-SI] 400kV Tumbri - Krsko 1 [OPP] [HR]	694	694	69.69%	50.83%	87.82%	0.3696	0.8764
[AT-SI] Obersielach - Podlog 247 [OPP] [AT]	686	1794	111.06%	61.16%	183.43%	0.2222	0.6883
[AT-SI] Obersielach - Podlog 247 [DIR] [AT]	686	1374	63.23%	20.94%	114.33%	0.2222	0.6883

Note 1: The shown z2zPTDF values do not correspond to the maximum zone-to-zone PTDFs according to equation 5 of the Day-ahead CCM and hence are not the ones used for the CNEC Selection. The z2zPTDFs are calculated only between neighbouring BZs. See KPI reading guide on JAO.

Note 2: RAM for Core exchanges can be higher than 100% due to the relieving effect of Fuaf: RAM\_Core = CEP\_target - Fuaf. So if Fuaf is very negative you can get above 100%.

#### **KPI 12: Most limiting CNEs (top 20)**



CNE	Distinct hours CNE has shadow price	Count of CNECs with shadow price	Max shadow price [€/MW]	Avg RAM/Fmax	Min RAM/Fmax ♣	Max RAM/Fmax	Max z2zPTDF
[FR-D7] Vigy - Ensdorf VIGY2 S [DIR] [D7]	277	277	421.86	34.91%	17.89%	65.13%	0.2336
[D8-PL] Mikulowa PST1 [OPP] [PL]	152	152	291.34	40.18%	23.33%	67.35%	0.4382
[NL-BE] PST Zandvliet 2 [DIR] [BE]	108	120	897.7	59.53%	27.12%	89.99%	0.4644
[AT-SI] Obersielach - Podlog 247 [DIR] [AT]	102	103	1005.64	43.86%	20.94%	84.85%	0.2217
[AT-HU] Wien Suedost - Gyoer 245 [DIR] [AT]	64	64	1403.5	63.06%	36.32%	89.32%	0.0743
[NL-D2] Meeden-Diele 380 Z [OPP] [NL]	54	54	528.54	28.03%	19.85%	73.88%	0.2306
[NL-D2] Meeden-Diele 380 Z [DIR] [NL]	46	46	239.15	55.94%	20.42%	129.06%	0.2309
[RO-RO] TR Rosiori 400/220 1 [DIR]	46	46	262.86	52.30%	27.50%	76.50%	0.1411
[CZ-SK] Nosovice - Varin [DIR] [SK]	39	39	71.42	58.64%	40.94%	71.39%	0.453
[RO-RO] TR Portile de Fier 400/220 1 [OPP]	36	36	238.65	21.30%	0.00%	53.80%	0.1882
[AT-D2] St. Peter 2 - Pleinting 258 [DIR] [AT]	36	36	134.86	48.28%	27.05%	69.73%	0.1837
[D7-D7] Gronau - Gronau TR 441 E [DIR]	34	34	207.42	41.58%	29.27%	63.67%	0.2065
[CZ-PL] Wielopole - Nosovice [DIR] [PL]	30	30	148.86	42.63%	31.10%	59.88%	0.3848
[CZ-D8] Hradec - Rohrsdorf 445 [OPP] [D8]	28	28	166.04	34.45%	27.95%	48.45%	0.3953
[AT-HU] Neusiedl - Gyoer 246B [DIR] [AT]	28	28	700.37	46.15%	25.64%	70.09%	0.0765
[AT-AT] Strass - Thaur 273B [DIR]	27	27	133.51	70.85%	24.41%	107.84%	0.1239
[AT-AT] Hessenberg - Weissenbach 223 [OPP]	21	21	942.85	33.74%	20.44%	63.84%	0.0649
[NL-D7] Maasbracht - Oberzier SELFK WS [DIR] [D7]	19	19	607.39	67.31%	47.98%	86.89%	0.2727
[BE-FR] Achene - Lonny 380.19 [DIR] [BE]	14	14	445.2	83.96%	69.53%	96.46%	0.2951
[SK-UA] V.Kapusany - Mukachevo (WPS) [DIR] [SK]	14	14	5.44	78.17%	72.33%	86.12%	0.195

Note 1: The RAM values (expressed as % of Fmax) should not be interpreted as "the capacities offered by the Core TSOs to the market coupling". Indeed, since the introduction of Ext LTA inclusion Euphemia performs an optimization where it takes a portion of the FB domain and a portion of the LTA domain to maximize welfare. The RAM value shown in this KPI report correspond to the "portion of the FB domain" resulting from this optimization

Example:

- RAM = 500MW
- Portion of FB Domain = 40%
- RAM offered by Core TSOs = 400mW/0.4 = 1250MW


#### **KPI 13a: Allocation Constraints - Belgium**



	# MTUs
AC was Limiting MC	0


	BE AC Import [MW]
Avg.	-7927.82
Min.	-8529.00
Max.	-6802.00

Belgium only uses import allocation contraints

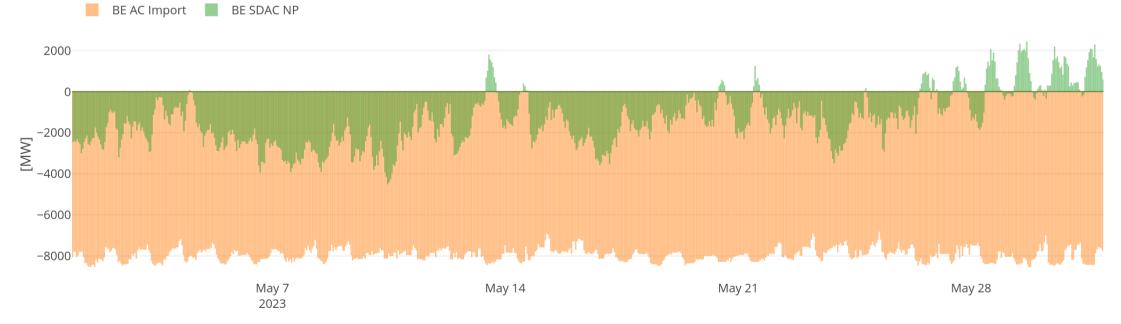

#### **KPI 13b: Allocation Constraints - Poland**



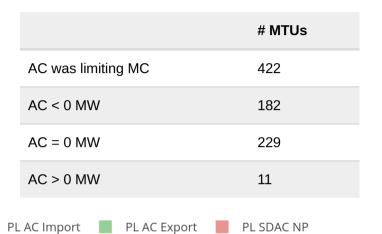

	PL AC Import [MW]	PL AC Export [MW]
Avg.	-927.33	3603.14
Min.	-7126.00	0.00
Max.	0.00	11498.00

